



*Manufacturers of Process
Controls and Instrumentation*

Instruction Manual

Model: *RCI-200-XXX*

Function: *Remote Control Signal Interface*

Communication: *XXX=SER: RS-232/485*
 XXX=MDM Modem Dial-Up
 XXX=FSK: Leased Line
 XXX=RF9: 900 Mhz Wireless
 XXX=RF150: 150 MHz Wireless

Input: 2 "Dry" Contacts and 2 Analog Inputs

Output: 2 Form 'C' Contacts and 2 Analog Outputs

Power: 117VAC, 50/60Hz
 24 VDC

Serial #: _____

(If special or required)

For Technical Assistance And Questions Call
USA: (231) 788-2900 CANADA: (905) 660-5336

Restocking Policy


All product returned to Pribusin Inc. in prime condition (not damaged, scratched or defaced in any way) within seven (7) months from the original date of shipment is subject to a 50% restocking charge. All product must be accompanied by a Return Authorization number (RA number) which must be obtained from Pribusin Inc. prior to returning any product.

After seven (7) months from the original date of shipment, products cannot be returned for restocking.

Custom designed products, modified products or all non-standard products may not be returned for restocking.

Warranty Policy

Pribusin Inc. warrants equipment of its own manufacture to be free from defects in material and workmanship, under normal conditions of use and service, and will replace any component found to be defective, on its return to Pribusin Inc., transportation charges prepaid, within one year of its original purchase. Pribusin Inc. will extend the same warranty protection on equipment, peripherals and accessories which is extended to Pribusin Inc. by the original manufacturer. Pribusin Inc. also assumes noliability, expressed or implied, beyond its obligation to prelace any component involved. Such warranty is in lieu of all other warranties, expressed or implied.

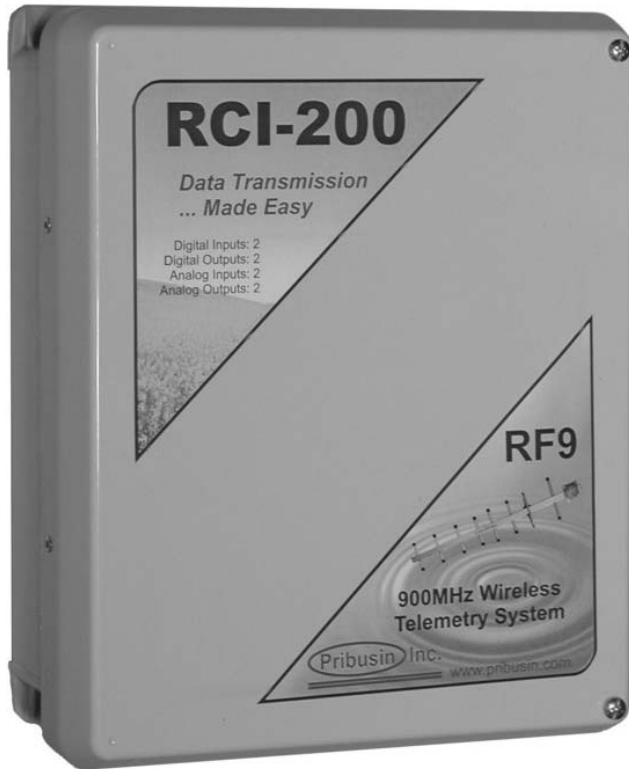

Standard Features:

- Bi-directional Communication using License-free 150MHz Radio Band
- 2 Watt selectable Radio Power Provides Reliable Communication
- 150MHz RF Band Does Not Require Line-Of-Sight
- 2 Dry Contact and 2 Analog Inputs
- 2 'C' Relay Contacts and 2 Analog Outputs
- Point-to-Point or Host-to-Multipoint Topologies
- No Calibration Required
- Microprocessor Controlled for High Accuracy
- Power: 117 VAC 50/60 Hz (Optional 24 VDC)
- High Noise Rejection



Function:

The RCI-200-RF9 is a bi-directional data communication system that exchanges the status of 2 dry contact inputs and 2 analog inputs between a master and one or more remote units. A basic system consists of one master station and one remote station each with 2 dry contact and 2 analog inputs and 2 'C' relay contact and analog outputs. All signals are bi-directional so that data may be read from the remote station and sent to it.

The license-free 150MHz radio technology allows small systems to be set up with very little effort and at low cost. The technology ensures high communication reliability even in RF-intensive environments.

Antennas, such as directional Yagi or Patch antennas, are sold separately.

Options:


- A: 24VDC Power
- B: 240VAC Power
- N12: NEMA 12 Enclosure

Specifications:





- Media: 150MHz Spread-Spectrum Radio
- Range: up to 12 miles with directional antenna
- Protocol: MODBUS ASCII, 9600 BAUD
- RF Connector: N-Female (Bottom of Enclosure)
- Radio Power Output: 1W, 2W (selectable)
- Operating Temperature: -4°F to +140°F (-20°C to +60°C)
- Relay Contacts: 10A 1/8Hp @ 125VAC
6A 1/8Hp @ 277VAC
- Power: 117 VAC, 60/50 Hz, 24VDC Available
- Enclosure: NEMA4X (NEMA12 available as an option)
- Approvals: ETL 3118354:
UL 60950-1-2007; CSA-C22.2 No. 60950-1-07

RCI-200-RF150

Enclosures & Dimensions:

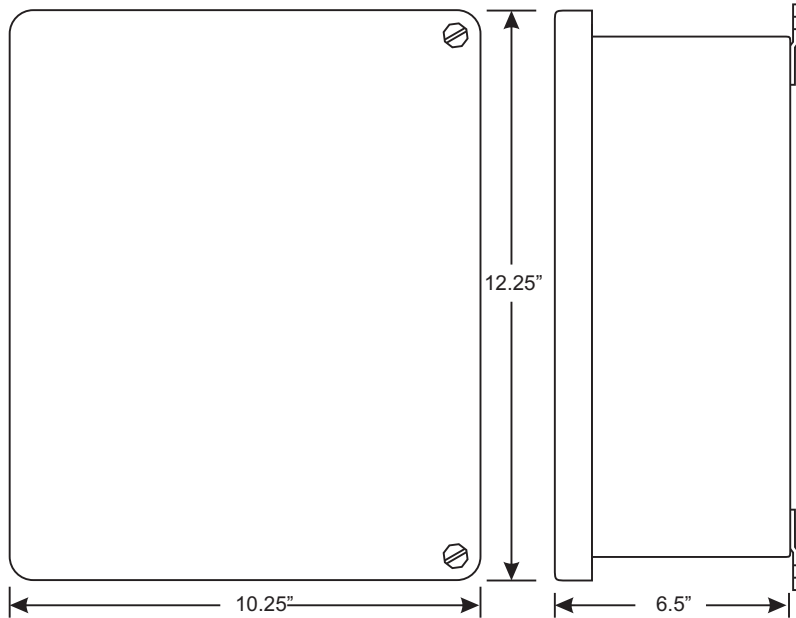

Connection:

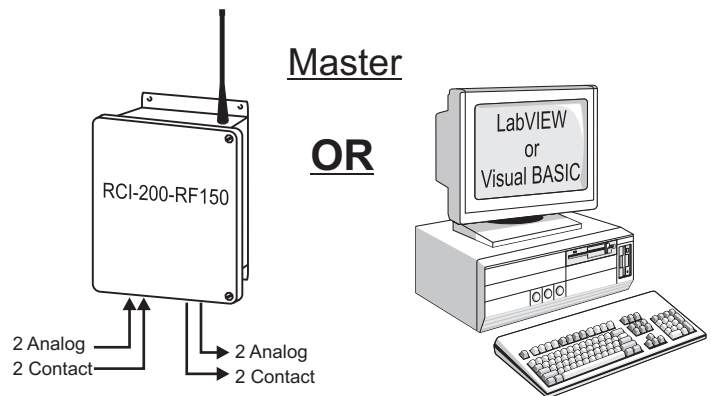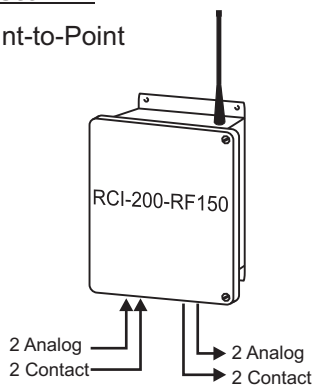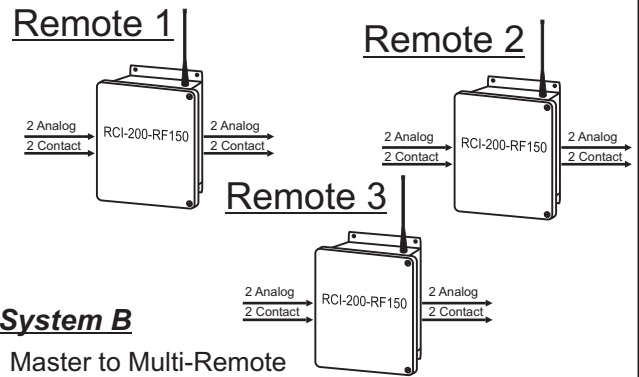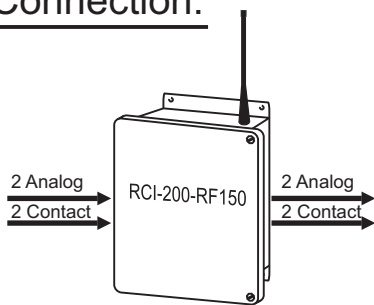

Manufactured By:



www.pribusin.com
info@pribusin.com

USA:

Pribusin Inc.
743 Marquette Ave.
Muskegon, MI 49442
Ph: (231) 788-2900
Fx: (231) 788-2929




CANADA:

Pribusin Inc.
101 Freshway Dr. Unit 57
Concord, Ontario, L4K 1R9
Ph: (905) 660-5336
Fx: (905) 660-4068

Mounting_Holes
6.02"



Pribusin Inc. ©	
CHKD: V.B	DATE: MAY14/10
DRN: D.P	
RCI-200 ENCLOSURE DIMENSION	
DWG. NO.: 108125	REV. A

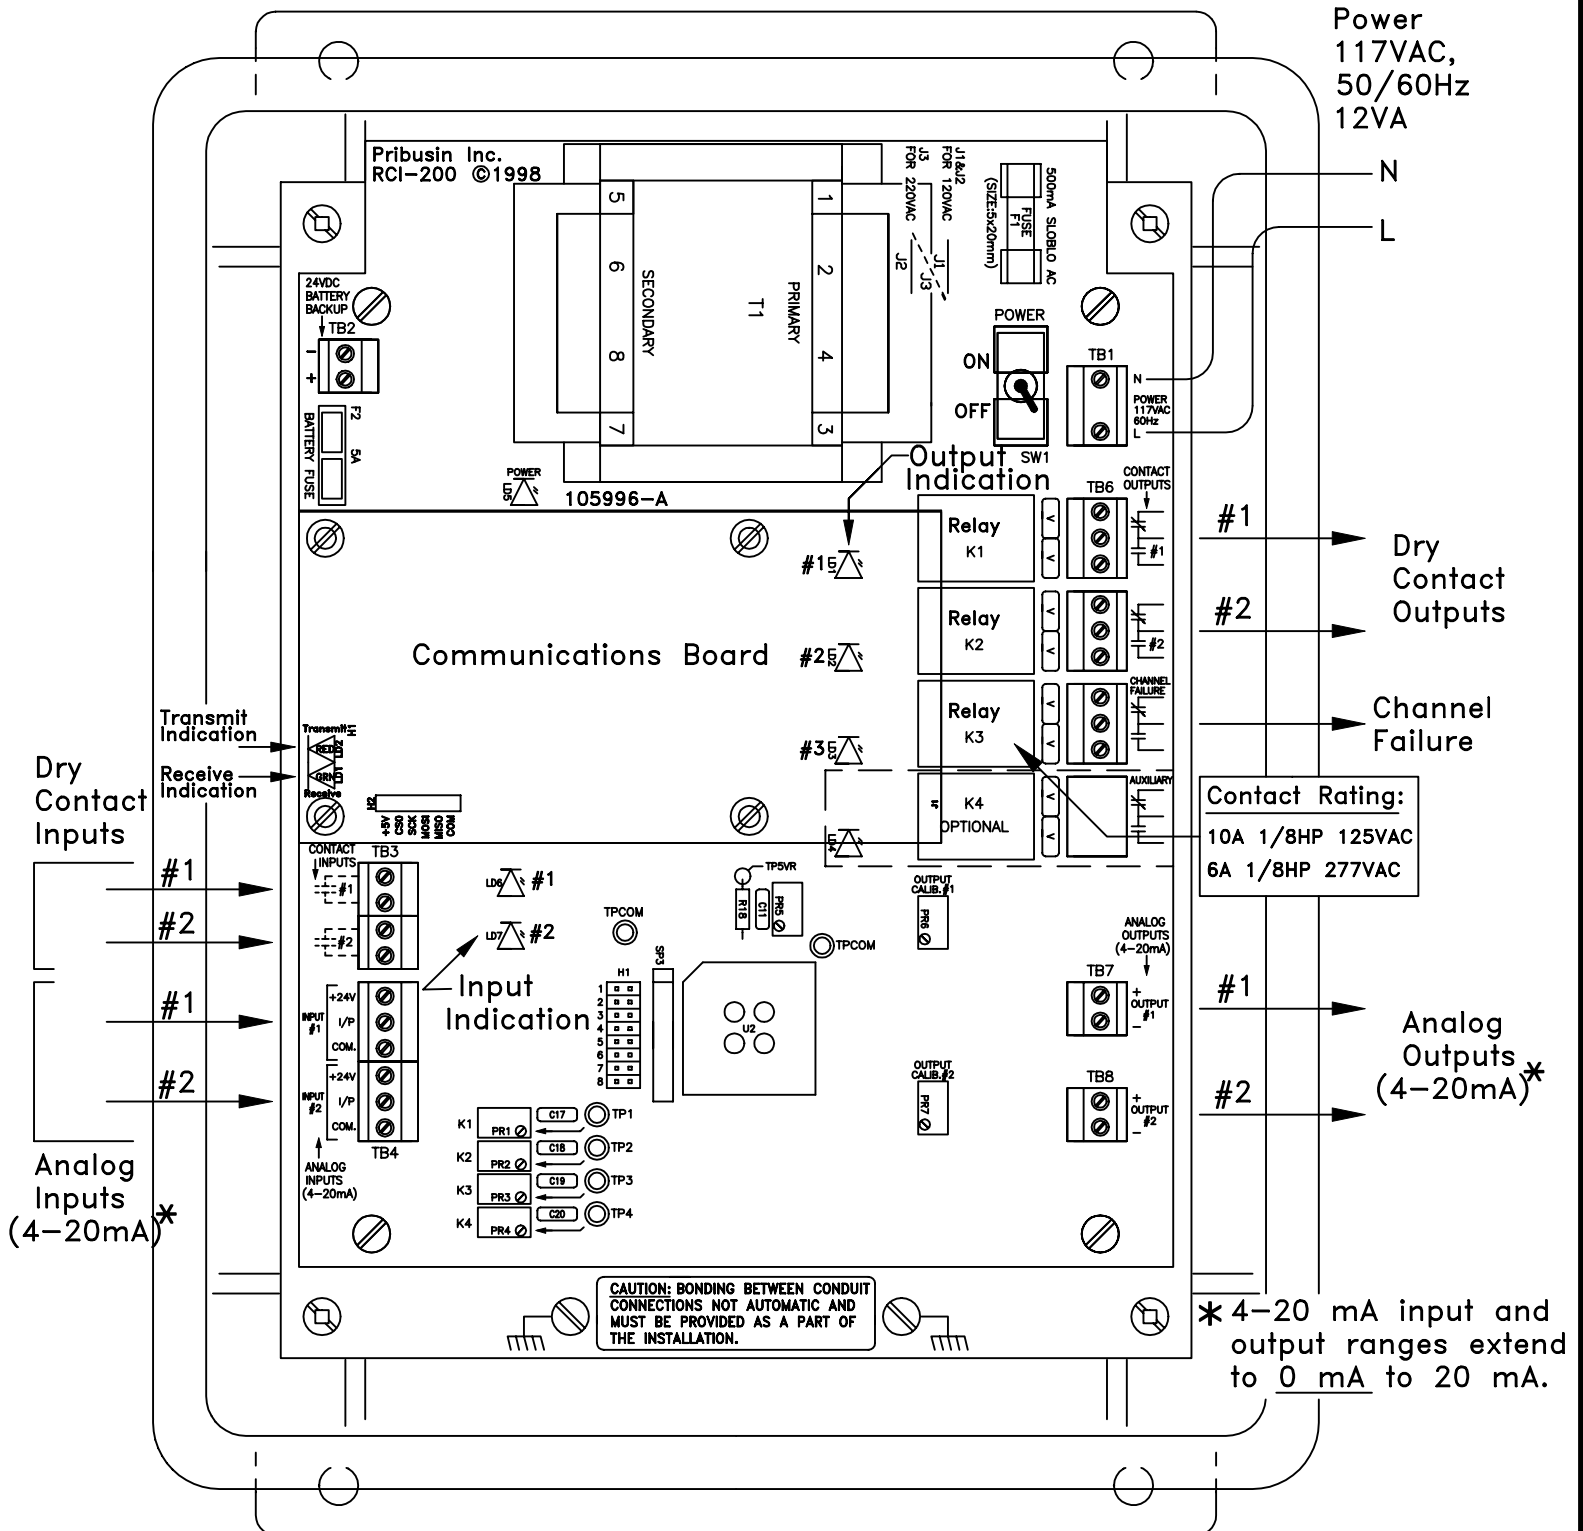

Power
117VAC,
50/60Hz
12VA

N
L

#1 → Dry Contact Outputs
#2 → Dry Contact Outputs
Channel Failure

Contact Rating:
10A 1/8HP 125VAC
6A 1/8HP 277VAC

#1 → Analog Outputs (4-20mA)*
#2 → Analog Outputs (4-20mA)*

* 4-20 mA input and output ranges extend to 0 mA to 20 mA.

Pribusin Inc. ©		
CHKD :	DATE : Apr. 15/99	DRN : KS
Model: RCI-200-XXX Remote Control Signal Interface		
DWG. NO. :	106125	REV. B


RCI-200 Connections:

The RCI-200 is the main board of an RCI-200-XXX Telemetry system. It provides the input and output signal connections as well as the power supply for the unit. A separate communications board is added to the RCI-200 to allow it to communicate with other units. This communications board may have its own configuration that is in a separate section of this manual. The following configuration applies only to the RCI-200 board and is common to all communications interfaces.

AC Power & Fuse:


The RCI-200 is typically powered from 120VAC and protected by a 125mA SLOBLO fuse. It can be wired for 240VAC operation by removing (de-soldering) power jumpers J1 & J2 and installing (soldering) jumper J3.

When changing the RCI-200 to 240VAC power make sure to change the fuse to half of its value, 80mA. This is important since at 240VAC the RCI-200 requires only half the current as if it were powered from 120VAC. Proper protection is only achieved by reducing the fuse value as mentioned above.

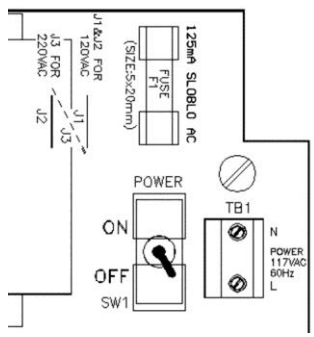


DC Power & Battery Backup:


The RCI-200 may also be powered from a 24VDC source which could be a battery or a DC power supply. The 24VDC power input is polarity protected with a fuse to prevent damage to the RCI-200 by inadvertent reverse polarity. A DC fuse provision is also provided if this power option is utilized. Insert a 5A automotive type blade fuse into the Battery Fuse socket.

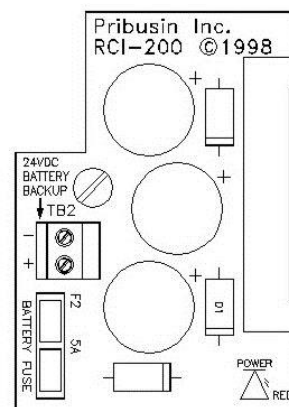

Inputs:





The RCI-200 has two dry contact inputs and two 0-20mA inputs. The dry contact inputs are excited with 24VDC and will source approximately 20mA when the contact is closed. A red LED lights up when a contact input is closed.




The analog inputs are configured as 0-20mA inputs and have a 250Ω input impedance. Each input terminal has three connections: +24V, I/P, COM. The +24V power output may be used to power field transmitters. Up to 500mA may be used to power a transmitter. The input signal is connected to I/P(+) and COM(-).

Analog inputs are connected to the RCI-800 in two fashions: 1) Normal (3-wire connection) or 2) two-wire connection. On a 3-wire connected input, an external power supply or the +24V power output terminal of the RCI provides power to the field transmitter. The field transmitter has a current source that provides the 4-20mA signal back to the RCI-800. If using the power supply of the RCI-800, the field transmitter may draw up to 125mA. A total of 1A is available to power up to 8 field transmitters.

On a 2-wire connected input, the field transmitter receives power from the RCI-800 and superimposes the signal onto the power return path. A maximum of 20mA will flow in such a connection. Make sure to consult the field transmitter manual to determine how to connect it to the RCI-800.

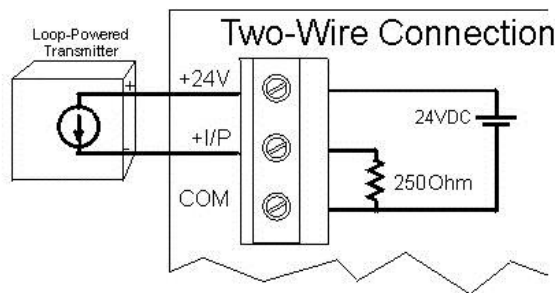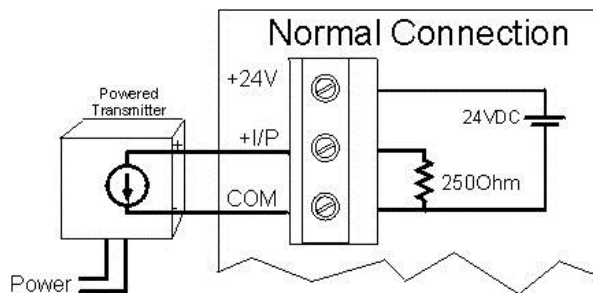

Outputs:

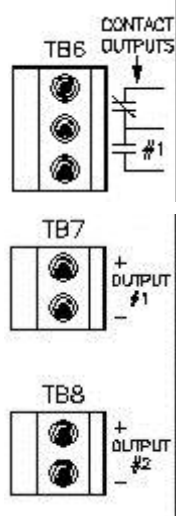


The RCI-200 has two form 'C' relay contact outputs and two 0-20mA analog outputs. The relay contacts are capable of switching 120VAC, 10A or 240VAC, 6A. An energy absorbing varistor is installed across each contact to limit switching transients. A third relay contact acts as a communications fail indicator. If no communication occurred within 30 seconds, this relay contact will energize. Upon re-established communication this relay will de-energize again.

The two analog outputs are typically configured as 0-20mA outputs and can drive into a 1000Ω load each, provided that the power supply to the unit is not below 24VDC. The outputs are not isolated from each other or from the inputs. Care must be taken when connecting the outputs to different devices so that no inadvertent ground loops are established.

Output Calibration & Input Testing:

The outputs on the RCI-200 are factory calibrated and should not require any adjustments. To check the calibration of the outputs and relays use jumpers H1-7 & H1-8 as shown below to set them to known states. If an output should require some adjustment, insert jumper H1-8 only and turn the OUTPUT CALIB. trim pot until the output reads 20mA.

H1-7	H1-8	Function
OUT	OUT	Normal Operation
OUT	IN	Outputs=20mA, Relays=Energized
IN	OUT	Outputs=0mA, Relays=De-energized
IN	IN	Outputs=Inputs, Relays=Contact Inputs

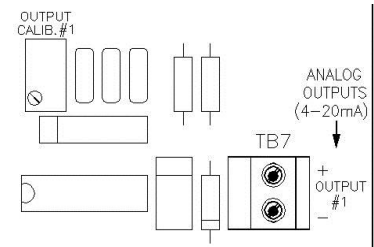

If both jumpers are IN the analog and contact inputs are passed straight through to the analog and relay outputs. This may help in troubleshooting input and output signals.


Make sure both jumpers are removed before resuming normal operation.

RCI-200 Configuration:

The RCI-200 requires no configuration other than for its communication fail operation. In the event of a communications failure on the communications board, the RCI-200 can be set up to take various actions on its outputs. This may be desirable in order to place connected devices into a safe operating mode. By default factory setting, all outputs remain at their last known state if a communications failure occurs.

H1-	Function	OUT	IN
1	Relay Fail Mode	No Change	See H1-2
2	Relay Fail Status	De-Energize	Energize
3	Output Fail Mode	No Change	Ramp to K1/K2*
4			
5			
6			
7	I/O Calibration		
8	I/O Calibration		

- * If H1-3=IN then analog output #1 will ramp to the setting of K1 and analog output #2 will ramp to the setting of K2. Both outputs will change at a rate determined by the setting of K3. The settings of the trim pots can be read on test points TP_{1,2,3} using a voltmeter. The test points read a voltage of 0-5V for a 0-100% adjustment.

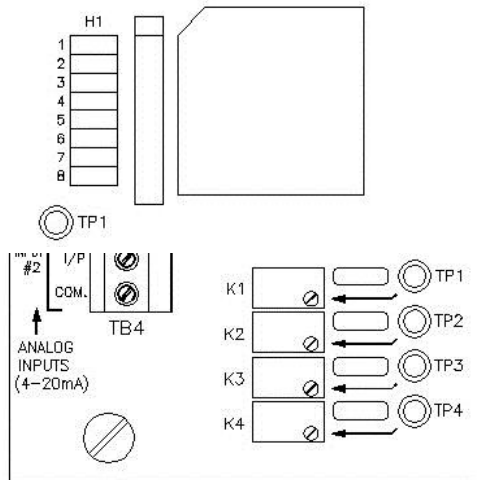

$$TP_{1,2} = \frac{Output}{20} \times 5Volt$$


$$TP_3 = \frac{RampRate}{60} \times 5Volt$$

where, *Output* = 0-20 (mA) and *Ramp Rate* = 0-60 (seconds) (5 sec. minimum)

RF150 Communication Option:

The –RF150 communications option to the RCI series utilizes license-free 150-154 MHz MURS Band radio frequency transmissions to exchange the signal data between a host and its remote(s). There are two types of **Topologies** that can be configured: 1) Point-to-Point and 2) Host-to-Multipoint.


In a **Point-to-Point** topology one host communicates with one remote. The two exchange all their signals with one another. The remote is configured as remote #1 even though it is the only remote in the system.

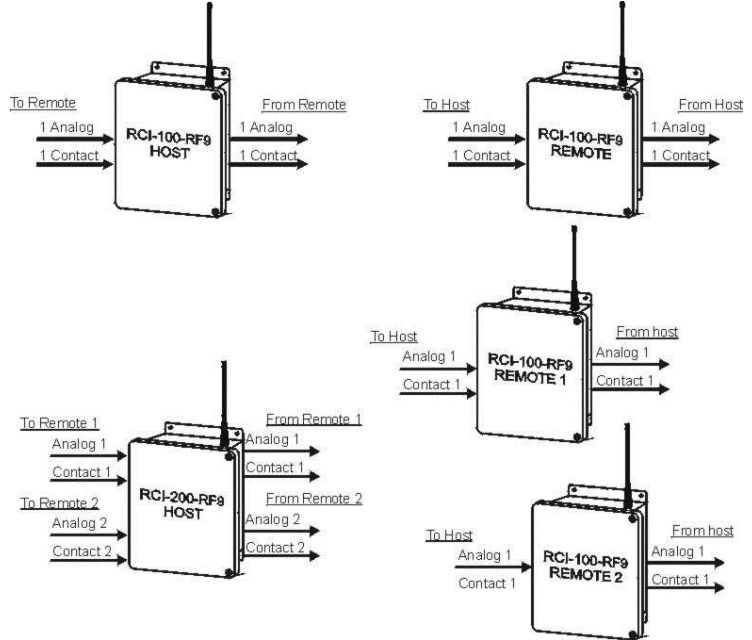

In a **Host-to-Multipoint** topology one host communicates to several remotes. Each remote is assigned an address (1,2,3, etc.) so that the host may distinguish between them. There may at most be as many remotes as there are inputs & outputs on the host.

For example, an RCI-200, having two analog/contact inputs and outputs, may communicate with up to two RCI-100 remotes each having one analog/contact input and output. In this case all **#1 inputs and outputs on the host correspond to the #1 inputs and outputs on remote #1** and all **#2 inputs and outputs on the host correspond to the #1 inputs and outputs on remote #2**. The second analog/contact input and output on each of the two remotes would be unused.

All radio configurations are done via two banks of DIPswitches. SW1 assigns the remote address from 1 to 9 using a binary encoding scheme. SW2 assigns the Topology, Channel ID, Channel Numbers and Host/Remote Mode. The switches are located on the left side of the communications board. They are slide type switches that slide **up for ON** and **down for OFF**.

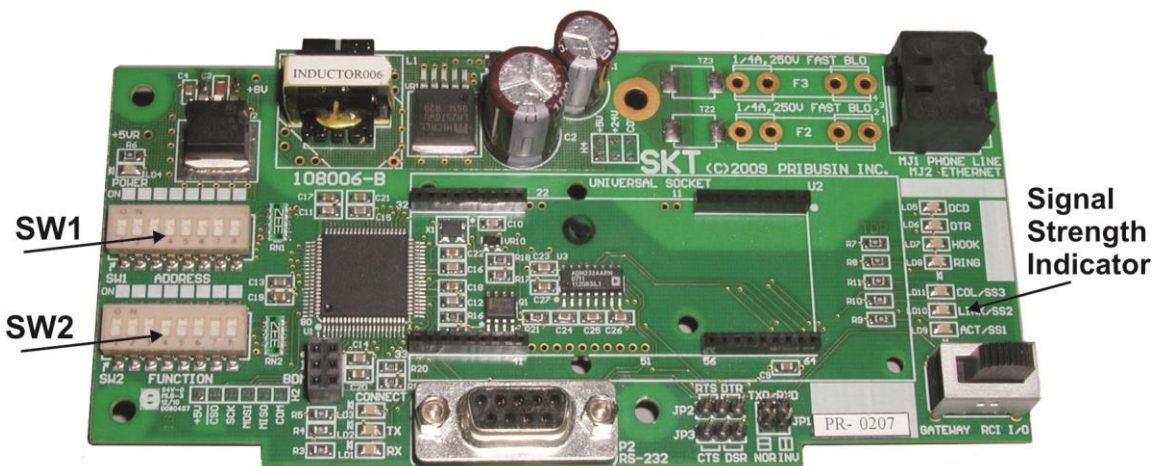

Radio Interface

Radio Configuration:

The radio communication board has two banks of 8-position DIP switches: SW1 and SW2. The function of these switches is slightly different for a host unit and a remote unit. We recommend powering the unit down while making any changes to the configuration.

SW1-	HOST	REMOTE
1	# of Remotes	Remote Address
2	# of Remotes	Remote Address
3	# of Remotes	Remote Address
4	Interrogation Interval	Interrogation Interval
5	Interrogation Interval	Interrogation Interval
6	Reply Timeout	Reply Timeout
7	RF Test Mode	RF Test Mode
8		





SW2-	HOST	REMOTE
1	# of Channels on each Remote	# of Channels on this Remote
2	# of Channels on each Remote	# of Channels on this Remote
3	# of Channels on Host	
4	# of Channels on Host	
5	MURS Channel	MURS Channel
6	MURS Channel	MURS Channel
7	RF Output Power	RF Output Power
8	Host / Remote Select	Host / Remote Select

Common settings: These settings are common for both Host and Remote units and must be set to the same settings in order for the system to operate properly.

MURS Channel Selection:

The MURS Channel Selection is common to both the host and remote modes of operation. All hosts and remotes that are intended to communicate with each other must be set to the same MURS Channel. Four channels are available: 1, 2, 3, 4. They are set as shown in the table.



SW2-5	SW2-6	Network ID
OFF	OFF	1
ON	OFF	2
OFF	ON	3
ON	ON	4

MURS Channel 1 151.820 MHz	 SW2- FUNCTION
MURS Channel 2 151.890 MHz	 SW2- FUNCTION
MURS Channel 3 151.940 MHz	 SW2- FUNCTION
MURS Channel 4 154.570 MHz	 SW2- FUNCTION

RF Output Power:

The radio output power can be selected with SW2-7. For shorter transmission ranges select the 1W range to limit the amount of 'RF pollution'. Select the 2W setting if there is no communication at the 1W setting.


SW2-7	RF Power
OFF	1 Watt
ON	2 Watts

RF Power = 1 Watt	 SW2- FUNCTION
RF Power = 2 Watts	 SW2- FUNCTION

Interrogation Interval:

This parameter determines how often the radios connect to update the input and output signals.


SW1-4	SW1-5	Interrogation interval
OFF	OFF	10 sec
ON	OFF	30 sec
OFF	ON	1 min
ON	ON	5 min

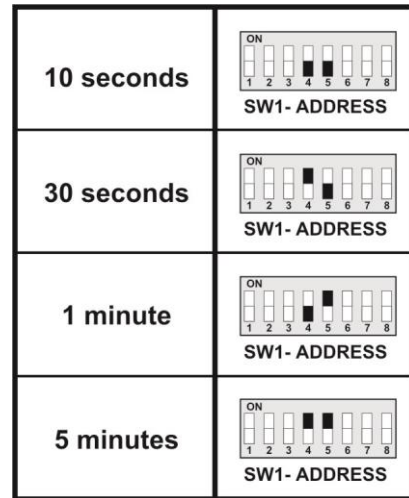

Reply Timeout:

The default reply timeout of 1 second is adequate for most applications. If a longer timeout is required it may be set to 10 seconds


SW1-6	Reply Timeout (sec)
OFF	1
ON	10

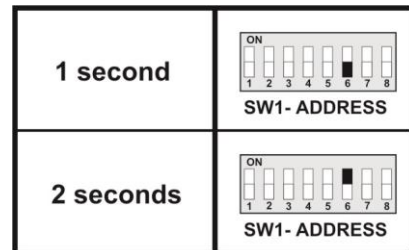

RF Test Mode:

If the RF Test Mode is enabled, the radio will send out a continuous tone on the selected MURS channel. This can be useful during troubleshooting but should never be enabled for a long time since it may cause interference with other MURS radio systems.


SW1-7	RF Test Mode
OFF	Disabled
ON	Enabled

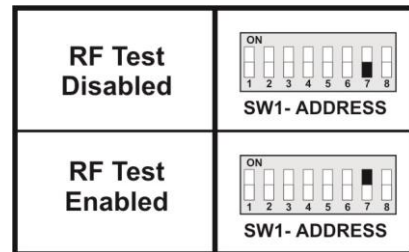

NOTE: While the RF Test Mode is enabled, the RCI will NOT transmit any I/O signals.


Host Configuration:

To make an RCI-200 operate as a host unit, make sure that SW2-8 is flipped down.

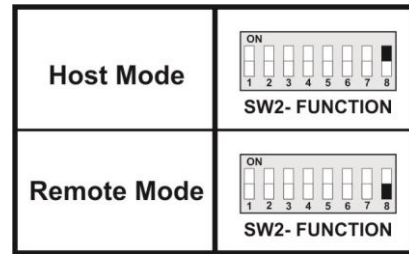


Next, set the **number of remotes** that the host is to communicate with using SW1-1, -2, -3. These switches are binary encoded as shown in the chart to the right.

SW1-1	SW1-2	SW1-3	# of Remotes
OFF	OFF	OFF	1
ON	OFF	OFF	2

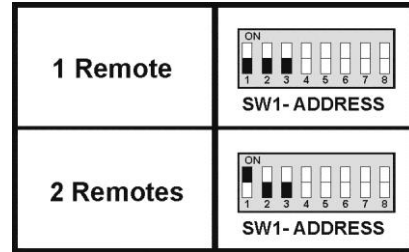


Next, set the **number of channels of each remote** using SW2-1, -2. One channel is considered 1 analog input/output plus 1 contact input/output. Hence an RCI-200 can have at most 2 channels.

SW2-1	SW2-2	Channels on Remotes
OFF	OFF	1
ON	OFF	2

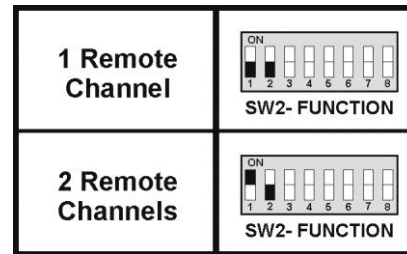


Next, set the **number of channels of the host** using SW2-3, -4. An RCI-200 can at most have 2 channels. This is the number of channels that will be exchanged between the host and each remote.

SW2-3	SW2-4	Channels on Host
OFF	OFF	1
ON	OFF	2

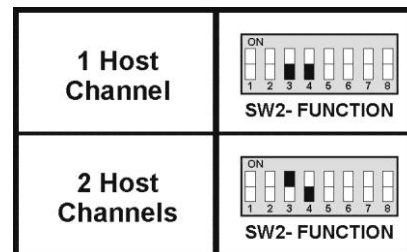


Remote Configuration:

To make an RCI-200 operate as a REMOTE unit, make sure that SW2-8 is switched OFF.

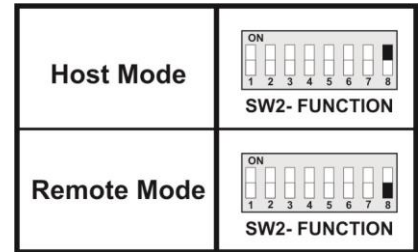


Next, set the **remote address** using SW1-1, -2 & -3. Each remote in a system must have a unique address.

SW1-1	SW1-2	SW1-3	Remote Address
OFF	OFF	OFF	1
ON	OFF	OFF	2
OFF	ON	OFF	3
ON	ON	OFF	4
OFF	OFF	ON	5
ON	OFF	ON	6
OFF	ON	ON	7
ON	ON	ON	8

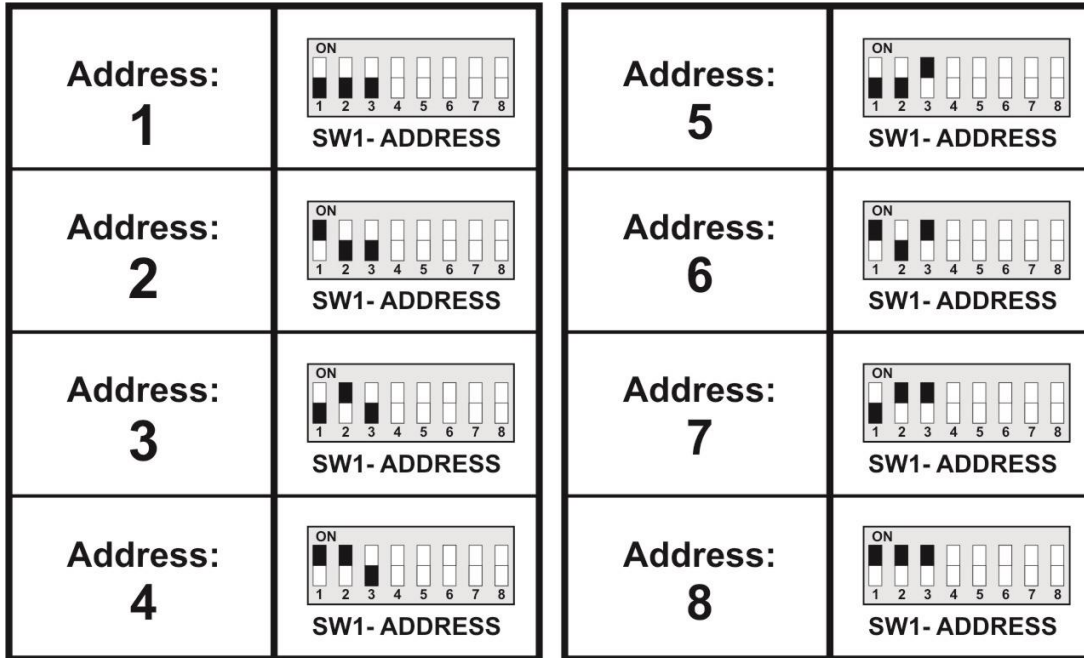

Next, set the **number of channels on this remote** using SW2-1. One channel is considered 1 analog input/output plus 1 contact input/output. Hence an RCI-200 can have at most 2 channel.

SW2-1	SW2-2	Channels on Remotes
OFF	OFF	1
ON	OFF	2

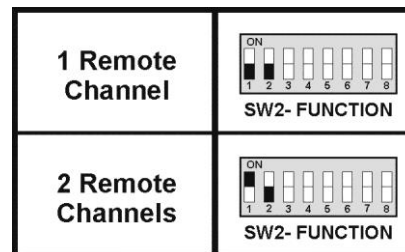

Point-to-Point Communication

Communication between one host and one remote is called point-to-point.


Example 1: An RCI-100 Host communicating with an RCI-100 Remote




SW1-ADDRESS



SW1-ADDRESS



SW2-FUNCTION



SW2-FUNCTION

RCI-100 (Host)

Host Channels: **1** Interval: **10 sec.**
 Number of Remotes: **1** MURS Channel: **1**
 Channels on Remotes: **1** Power: **1 Watt**

RCI-100 (Remote)

Remote Channels: **1** Interval: **10 sec.**
 Address: **1** MURS Channel: **1**
 Power: **1 Watt**

Example 2: An RCI-200 Host communicating with an RCI-200 Remote




SW1-ADDRESS



SW1-ADDRESS



SW2-FUNCTION



SW2-FUNCTION

RCI-200 (Host)

Host Channels: **2** Interval: **10 sec.**
 Number of Remotes: **1** MURS Channel: **1**
 Channels on Remotes: **2** Power: **1 Watt**

RCI-200 (Remote)

Remote Channels: **2** Interval: **10 sec.**
 Address: **1** MURS Channel: **1**
 Power: **1 Watt**

Example 3:

An RCI-400 Host communicating with an RCI-400 Remote



SW1-ADDRESS



SW1-ADDRESS



SW2-FUNCTION



SW2-FUNCTION


RCI-400 (Host)

Host Channels: **4** Interval: **10 sec.**
 Number of Remotes: **1** MURS Channel: **1**
 Channels on Remotes: **4** Power: **1 Watt**

RCI-400 (Remote)

Remote Channels: **4** Interval: **10 sec.**
 Address: **1** MURS Channel: **1**
 Power: **1 Watt**

Example 4: An RCI-800 Host communicating with an RCI-800 Remote



SW1-ADDRESS



SW1-ADDRESS



SW2-FUNCTION



SW2-FUNCTION

RCI-800 (Host)

Host Channels: **8** Interval: **10 sec.**
Number of Remotes: **1** MURS Channel: **1**
Channels on Remotes: **8** Power: **1 Watt**

RCI-800 (Remote)

Remote Channels: **8** Interval: **10 sec.**
Address: **1** MURS Channel: **1**
PHP: **1** Power: **1 Watt**

Point-to-Multipoint Communication

Communication between a host and more than one remote is called point-to-multipoint.

Example 1: An RCI-200 Host communicating with (2) RCI-100 Remotes



SW1-ADDRESS




SW2-FUNCTION

RCI-200 (Host)

Host Channels: **2**
 Number of Remotes: **2**
 Channels on Remotes: **1**
 MURS Channel: **1**
 Power: **1 Watt**



SW1-ADDRESS



SW2-FUNCTION

RCI-100 (Remote 1)

Remote Channels: **1**
 Address: **1**
 MURS Channel: **1**
 Power: **1 Watt**



SW1-ADDRESS




SW2-FUNCTION

RCI-100 (Remote 2)

Remote Channels: **1**
 Address: **2**
 MURS Channel: **1**
 Power: **1 Watt**

Example 2: An RCI-400 Host communicating with (2) RCI-200 Remotes



SW1-ADDRESS



SW2-FUNCTION

RCI-400 (Host)

Host Channels: **4**
 Number of Remotes: **2**
 Channels on Remotes: **2**
 MURS Channel: **3**
 Power: **1 Watt**



SW1-ADDRESS



SW2-FUNCTION

RCI-200 (Remote 1)

Remote Channels: **2**
 Address: **1**
 MURS Channel: **3**
 Power: **1 Watt**



SW1-ADDRESS





SW2-FUNCTION

RCI-200 (Remote 2)


Remote Channels: **2**
 Address: **2**
 MURS Channel: **3**
 Power: **1 Watt**

Example 3: An RCI-800 Host communicating with (2) RCI-400 Remotes





RCI-800 (Host)

Host Channels: **8**
 Number of Remotes: **2**
 Channels on Remotes: **4**
 Interrogation: **30 sec.**
 MURS Channel: **1**
 Power: **2 Watt**



RCI-400 (Remote 1)



Remote Channels: **4**
 Address: **1**
 Interrogation: **30 sec.**
 MURS Channel: **1**
 Power: **2 Watt**



RCI-400 (Remote 2)


Remote Channels: **4**
 Address: **2**
 Interrogation: **30 sec.**
 MURS Channel: **1**
 Power: **2 Watt**

Example 4: An RCI-800 Host communicating with (3) RCI-200 Remotes




RCI-800 (Host)

Host Channels: **8**
 Number of Remotes: **3**
 Channels on Remotes: **2**
 MURS Channel: **1**
 Power: **1 Watt**




RCI-200 (Remote 1)

Remote Channels: **2**
 Address: **1**
 MURS Channel: **1**
 Power: **1 Watt**



RCI-200 (Remote 2)

Remote Channels: **2**
 Address: **2**
 MURS Channel: **1**
 Power: **1 Watt**



RCI-200 (Remote 3)

Remote Channels: **2**
 Address: **3**
 MURS Channel: **1**
 Power: **1 Watt**

Received Signal Strength Indicator (RSSI):

The radio communications board has a signal strength indicator on the right hand edge to show the level of the signal that was received from another radio. The indicator consists of 3 LED's labeled SS1, SS2 & SS3. It is desirable to operate with the highest signal strength achievable. If the signal strength is less than -90dBm, it is advisable to try to make adjustments to the system to bring the signal strength up. A higher power setting on the radio or a higher gain antenna can be used to increase signal strength and achieve more reliable operation of the radio system.


Signal Strength (dBm)	LED 1	LED 2	LED 3
-105	Flashing	Off	Off
-100	On	Off	Off
-90	On	Flashing	Off
-80	On	On	Off
-60	On	On	Flashing
-50	On	On	On

Cable & Antenna Selection & Installation:


The antenna is a very important component in a radio system. Make sure you consult the factory for proper antenna selection for your project. Cable leading from the radio to the antenna is just as important in establishing a reliable link. Special low-loss cable is available to ensure minimal signal losses in the cable leading to the antenna. This cable must be kept as short as possible. We recommend purchasing the cable from Pribusin Inc. to ensure a good match for the entire system. **Regular TV coaxial cable or even satellite dish coaxial cable will not work.** Even 'good' TV cables have enormous losses at the high frequency of this radio.

Line-of-Sight Installation:

To achieve maximum operational reliability, all antennas in a system should be installed in a line-of-sight fashion. This means that there are no obstructions between the host antenna and each of the remote antennas. This may require the antenna to be raised on a mast with some low-loss coaxial cable being installed. We recommend coaxial cables be kept as short as possible and not exceed 100ft.

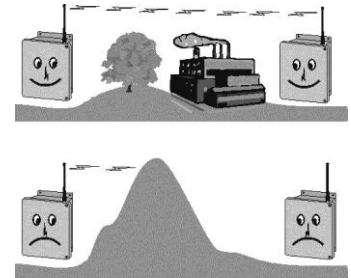


In some cases a direct line-of-sight may not be established, but if there are solid structures such as buildings, tanks etc. in the vicinity, the signal may reflect off these surfaces and reach an antenna via an indirect path. Such installations are not easy and are difficult to predict without on-site testing.

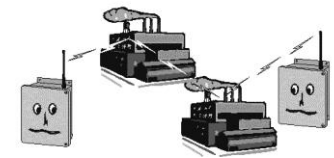

Antenna Polarization:

When installing antennas keep in mind that polarity matters. Alignment for antennas depends on the type of antennas being used. For example, if using omni-directional antennas, point them parallel to one another as shown in the diagram below. Do not point them in different directions or the range of the antennas will be greatly diminished to the point where no transmission may take place. If using an omni-directional and a YAGI antenna, align them perpendicular to one another with the YAGI pointing towards the OMNI. If using YAGI antennas, align them facing one another as shown in the diagram to the right. Placing them parallel to one another greatly diminishes the transmission between antennas.

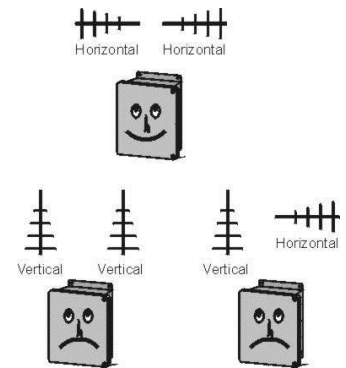

(YAGI-YAGI)



(OMNI-OMNI)

(OMNI-YAGI)

We suggest you consult Pribusin Inc. or your local Sales Rep. to discuss your antenna and cable requirements.